


Collection System I

Barbara Smith

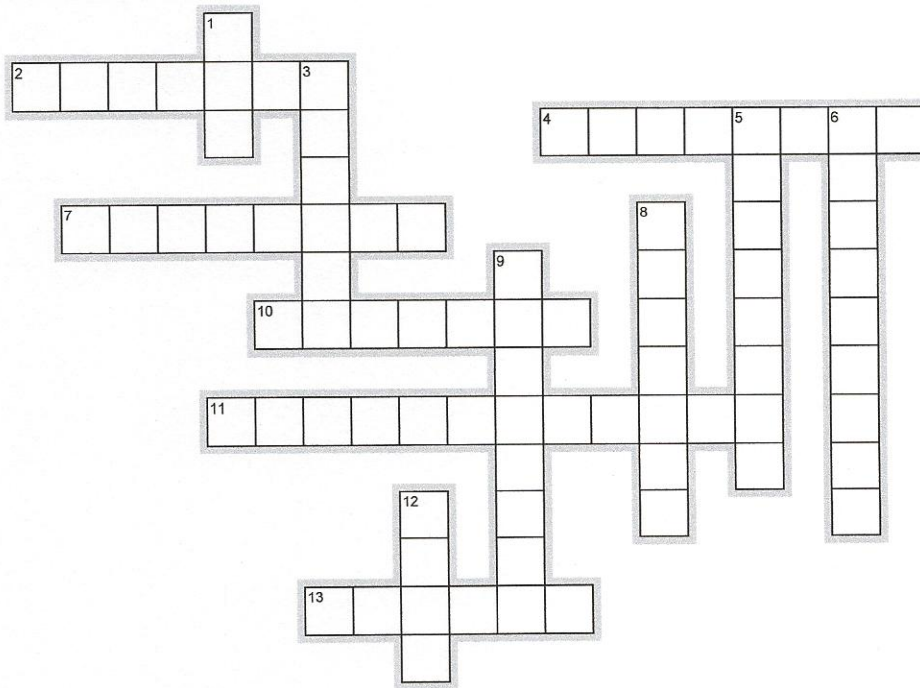

EclipseCrossword.com

Across

2. Must protrude 18" above the top of the excavation.
4. 2.0 ft/sec is the minimum scouring _ normally used for sanitary collection lines.
7. Is equivalent to 1.34 horsepower
10. Chlorine is _ than air
11. Bad joints is the most common reason for this
13. Spring blades are used with a power _.

Down

1. A bullet shaped object passed through a force main
3. In sewers this is mechanically removed by high pressure jets
5. The most common chemical used for odor control in sewers
6. Schedule 40 refers to pipe wall _.
8. Is a mechanical means to remove material from a sewer
9. If the discharge valve on a centrifugal pump is partially closed the amperage will _, discharge head will decrease.
12. Employers must provide employees with information about possible health effects from contact with hazardous material. It is called "right-to-know" this document provides that right.